
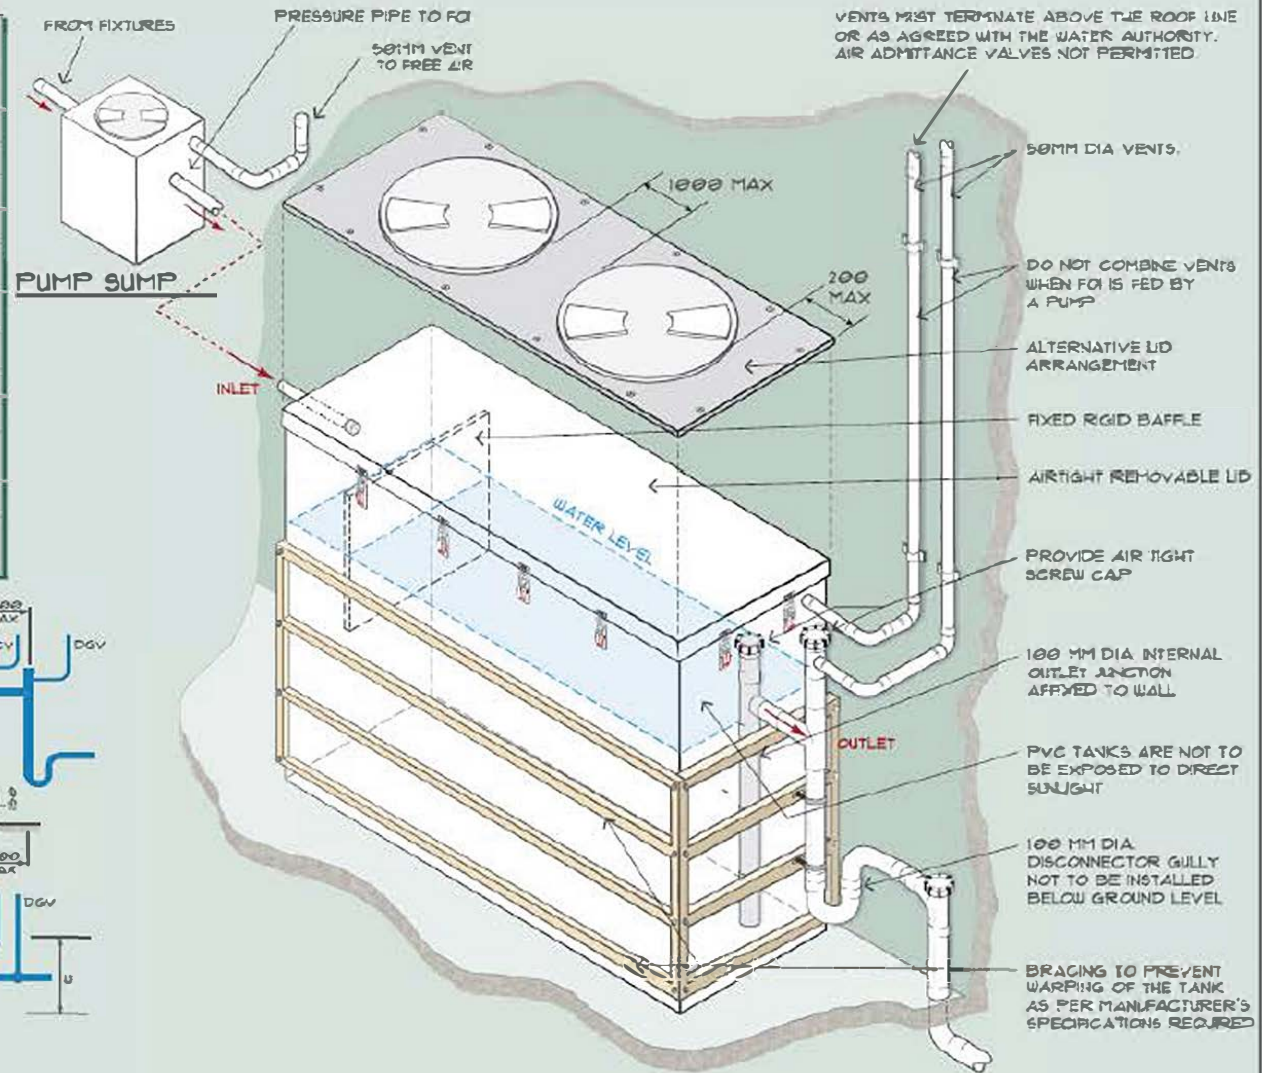


STANDARDS (ABOVE GROUND FO)

1. A TRADE WASTE APPLICATION MUST BE SUBMITTED BEFORE WORK COMMENCES
2. THE FOI SHALL HAVE A MINIMUM WATER CAPACITY AS SPECIFIED BY THE WATER AUTHORITY'S SIZING CRITERIA
3. THE RELEVANT COUNCIL HEALTH DEPARTMENT MAY HAVE CONDITIONS RELATING TO THE LOCATION OF THE FOI
4. INSTALLATION TO BE IN ACCORDANCE WITH THE RELEVANT PLUMBING REGULATIONS
5. THE FOI MUST BE INSTALLED BY A LICENSED PLUMBER AND A CERTIFICATE OF COMPLIANCE ISSUED BY THE PLUMBER
6. EASE OF ACCESS FOR REPAIRS AND MAINTENANCE IS REQUIRED. THE ENTIRE INTERNAL CHAMBER MUST BE EASILY ACCESSIBLE AT ALL TIMES
7. THE FOI SHALL NOT BE INSTALLED IN A CONFINED SPACE AS DEFINED BY THE WORKSAFE CODE OF VICTORIA
8. THE INSTALLATION OF REMOTE SUCTION LINES MUST BE IN ACCORDANCE WITH THE WATER AUTHORITY'S GUIDELINES
9. UNDERSIZED FOIS MAY NOT BE ACCEPTED
10. ALL TRADE WASTE GENERATING FIXTURES AS LISTED IN THE WATER AUTHORITY'S SIZING CRITERIA MUST BE CONNECTED TO THE FOI
11. ALL FOIS INSTALLED MUST COMPLY WITH THIS STANDARD DRAWING OR AS OTHERWISE VARED BY THE EXPRESS PERMISSION OF THE WATER AUTHORITY
12. NO ALTERNATE APPARATUS WILL BE ACCEPTED WITHOUT THE CONSENT OF THE WATER AUTHORITY
13. SUPPORT PLATFORMS, LADDERS AND HANDRAILS MUST BE INSTALLED IN ACCORDANCE WITH RELEVANT STANDARD - FIXED PLATFORMS, WALKWAYS, STAIRWAYS AND LADDERS (AS 4584)

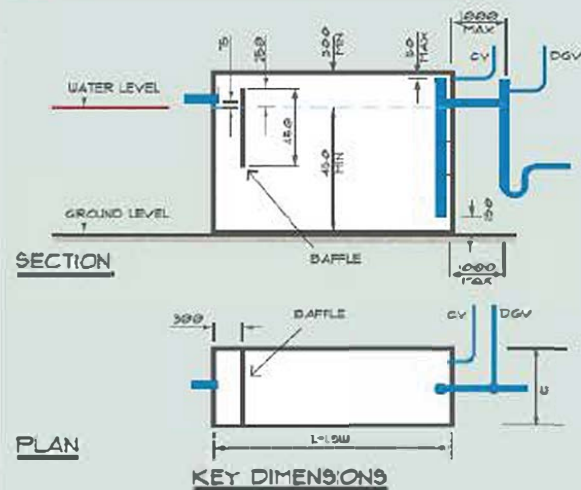

DRAWING NO

AM 15

REVISION

2

SCALE

NTS

DATE

DEC 2016

FOOD AND OIL INTERCEPTOR ABOVE GROUND INSTALLATION

